


Detalle de Zanja

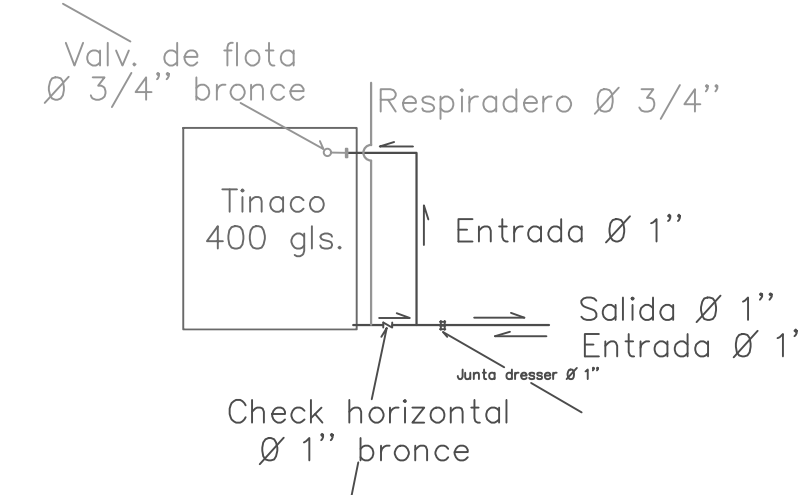

PARTIDAS AGUA POTABLE

ACOMETIDA 0 1/2" PVC(SCH-40) L=27.50 mt.
 TUBERIA 0 1/2" PVC(SCH-40) L=35.50 mt.
 TUBERIA 0 1" PVC(SCH-40) L=50.00 mt.
 TUBERIA 0 3/4" PVC(SCH-40) L=137.70 mt.
 TUBERIA 0 1/2" PVC(SCH-40) L=19.00 mt.
 Llave de paso 0 1" en Bronce 7.0 und.
 Llave de paso 0 3/4" en Bronce 4.0 und.
 Llave de chorro 0 1/2" en Bronce 4.0 und.

PIEZAS ESPECIALES

Tee 4"X2" PVC 1.0 und.
 Tapon 2" PVC 1.0 und.
 Clan 2"X1" PVC 1.0 und.
 Adapt. 0 1/2" PVC 1.0 und.
 Flota 0 1" bronce 1.0 und.
 Succion tub. 1" PVC(SCH-40) 3.50 mt.
 Check 1" bronce 1.0 und.
 Codo 1"x90 PVC presion 3.0 und.
 Adap. 0 1/2" PVC 1.0 und.
 Junta dresser 1" PVC 1 und.
 Equipo de bombeo 2 1/2 H.P. Qb=40 Gpm ; TDH=80 PSI 1 und.
 Tanque hidroneumatico 40 Gls y accesorios 1.0 und.
 Llave de paso entrada, salida y by-pass 3.0 und.
 Junta dresser 0 1/2" PVC 3.0 und.
 Codo 1 1/2"x45 PVC presion 1.0 und.
 Tee 1 1/2" X 1 1/2" PVC presion 5.0 und.
 Reduccion 1 1/2" x 1" Presion 4.0 und.
 Codo 1 1/2" x 90 PVC presion 1.0 und.
 Reduccion 1 1/2" @ 3/4" PVC 1 und.
 Codo 3/4" x 90 PVC presion 9.0 und.
 Tee 1" x 1" PVC 12.0 und.
 Reduccion 1" @ 1/2" PVC 10.0 und.
 Reduccion 1" @ 3/4" PVC 5.0 und.
 Tee 3/4"x3/4" PVC 8.0 und.
 Reduccion 3/4" @ 1/2" PVC 11.0 und.
 Codo 1"x90 PVC 1 und.
 Tinaco 400 Gls y accesorios 1.0 und.
 Cisterna 4,000 Gls, (4x3x1.60) 1 und.
 Salida para inodoro 6.0 und.
 Salida para lavamanos 8 und.
 Salida para ducha 2 und.
 Salida para lavadero 1 und.
 Salida para fregadero 1 und.

NOTA:
Plano para licitación.

PROYECTO Y DIRECCIÓN

Nuevo Domingo Savio
CONAPE

EJECUTOR DEL PROYECTO

URBE

PRESIDENCIA DE LA
REPÚBLICA DOMINICANA
MINISTERIO DE LA PRESIDENCIA

EQUIPO TÉCNICO

Unidad Ejecutora para la
Readecuación de Barrios y Entornos

DIBUJADO POR

Equipo Técnico de URBE

TÍTULO DE HOJA

Agua Potable

ESCALA DE LA HOJA

S/E

NÚMERO

SA-02

REVISIÓN

FECHA

#

Febrero 2023